


Figure 1: Schematic of Massachusetts DG Interconnection Review Process

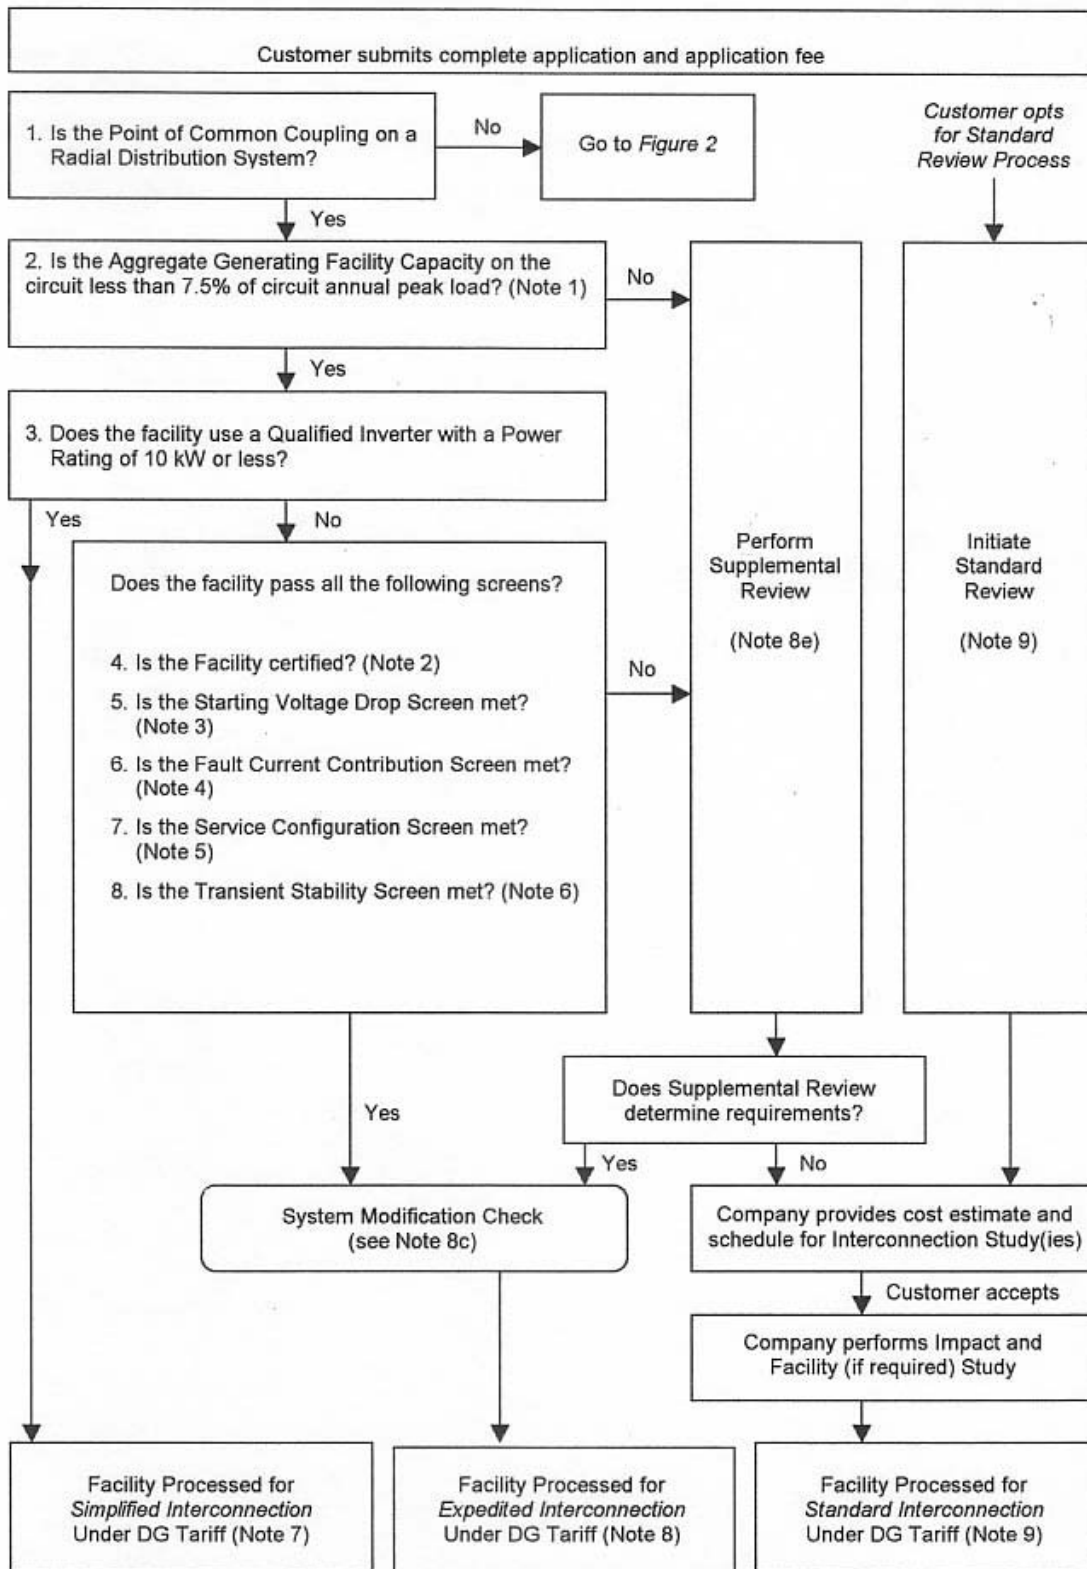


Figure

NARUC OCT. 03

**INTERCONNECTION PROCEDURES FOR
SMALL RESOURCES**

Super-Expedited Process:

Study Process:

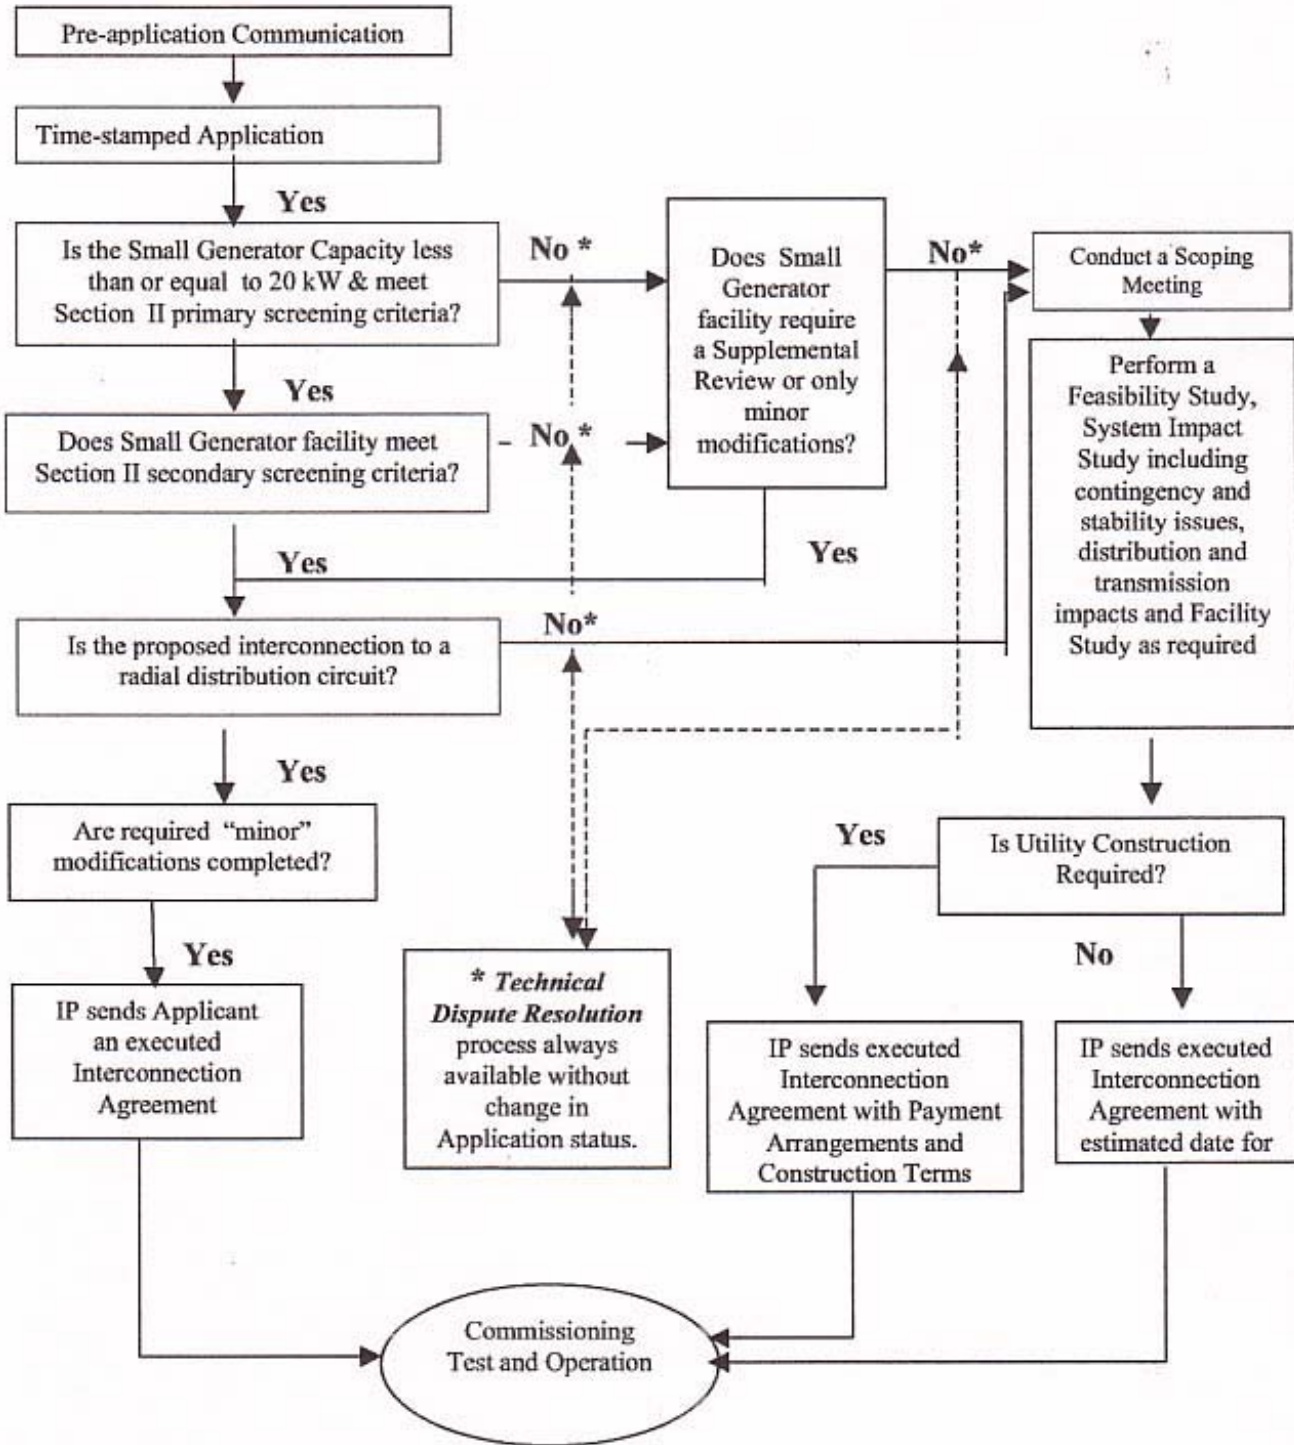


Rule 21
GENERATING FACILITY INTERCONNECTIONS

(Continued)

I. Review Process For Applications To Interconnect Generating Facilities (Continued)


Initial and Supplemental Review Process Flow Chart

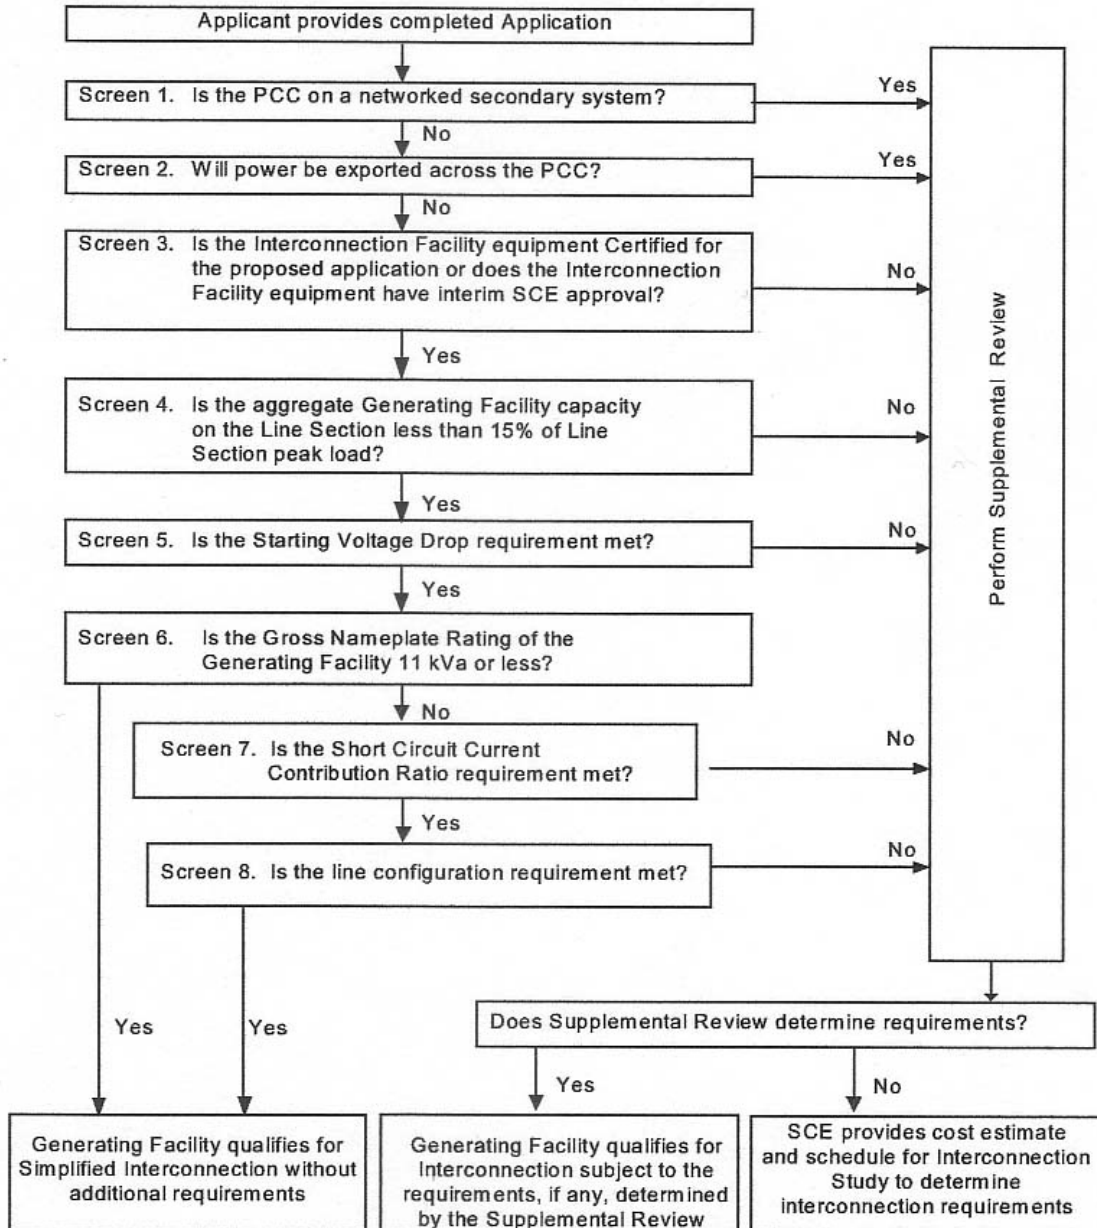

(Continued)

Flow Chart of Super-Expedited Procedures for Interconnecting a Small Generating Facility No Larger than 2 MW to a Low-Voltage Transmission System

Flow Chart of Super Expedited Procedures for Interconnecting a Small Generating Facility
No Larger than 2 MW to a Low-Voltage Transmission System

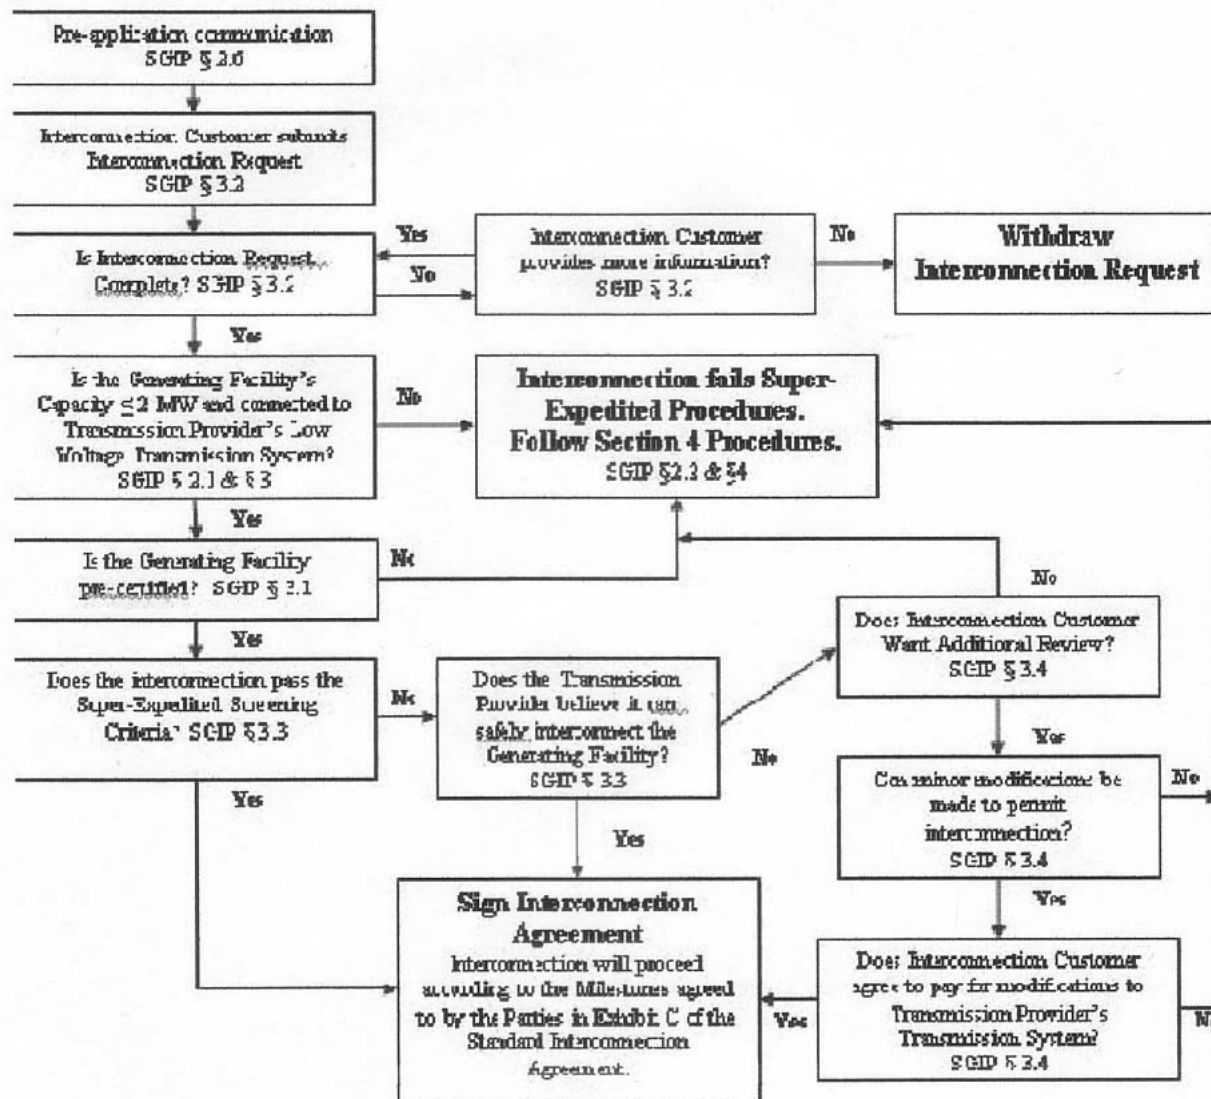

Flow Chart of Procedures for Interconnecting a Small Generating Facility to a High-Voltage Transmission System and a Small Generating Facility Larger than 2 MW to a Low-Voltage Transmission System

Flow Chart of Procedures for Interconnecting a Small Generating Facility to a High-Voltage Transmission System and a Small Generating Facility Larger than 2 MW to a Low-Voltage Transmission System

